


Thermozyklus – individual room control

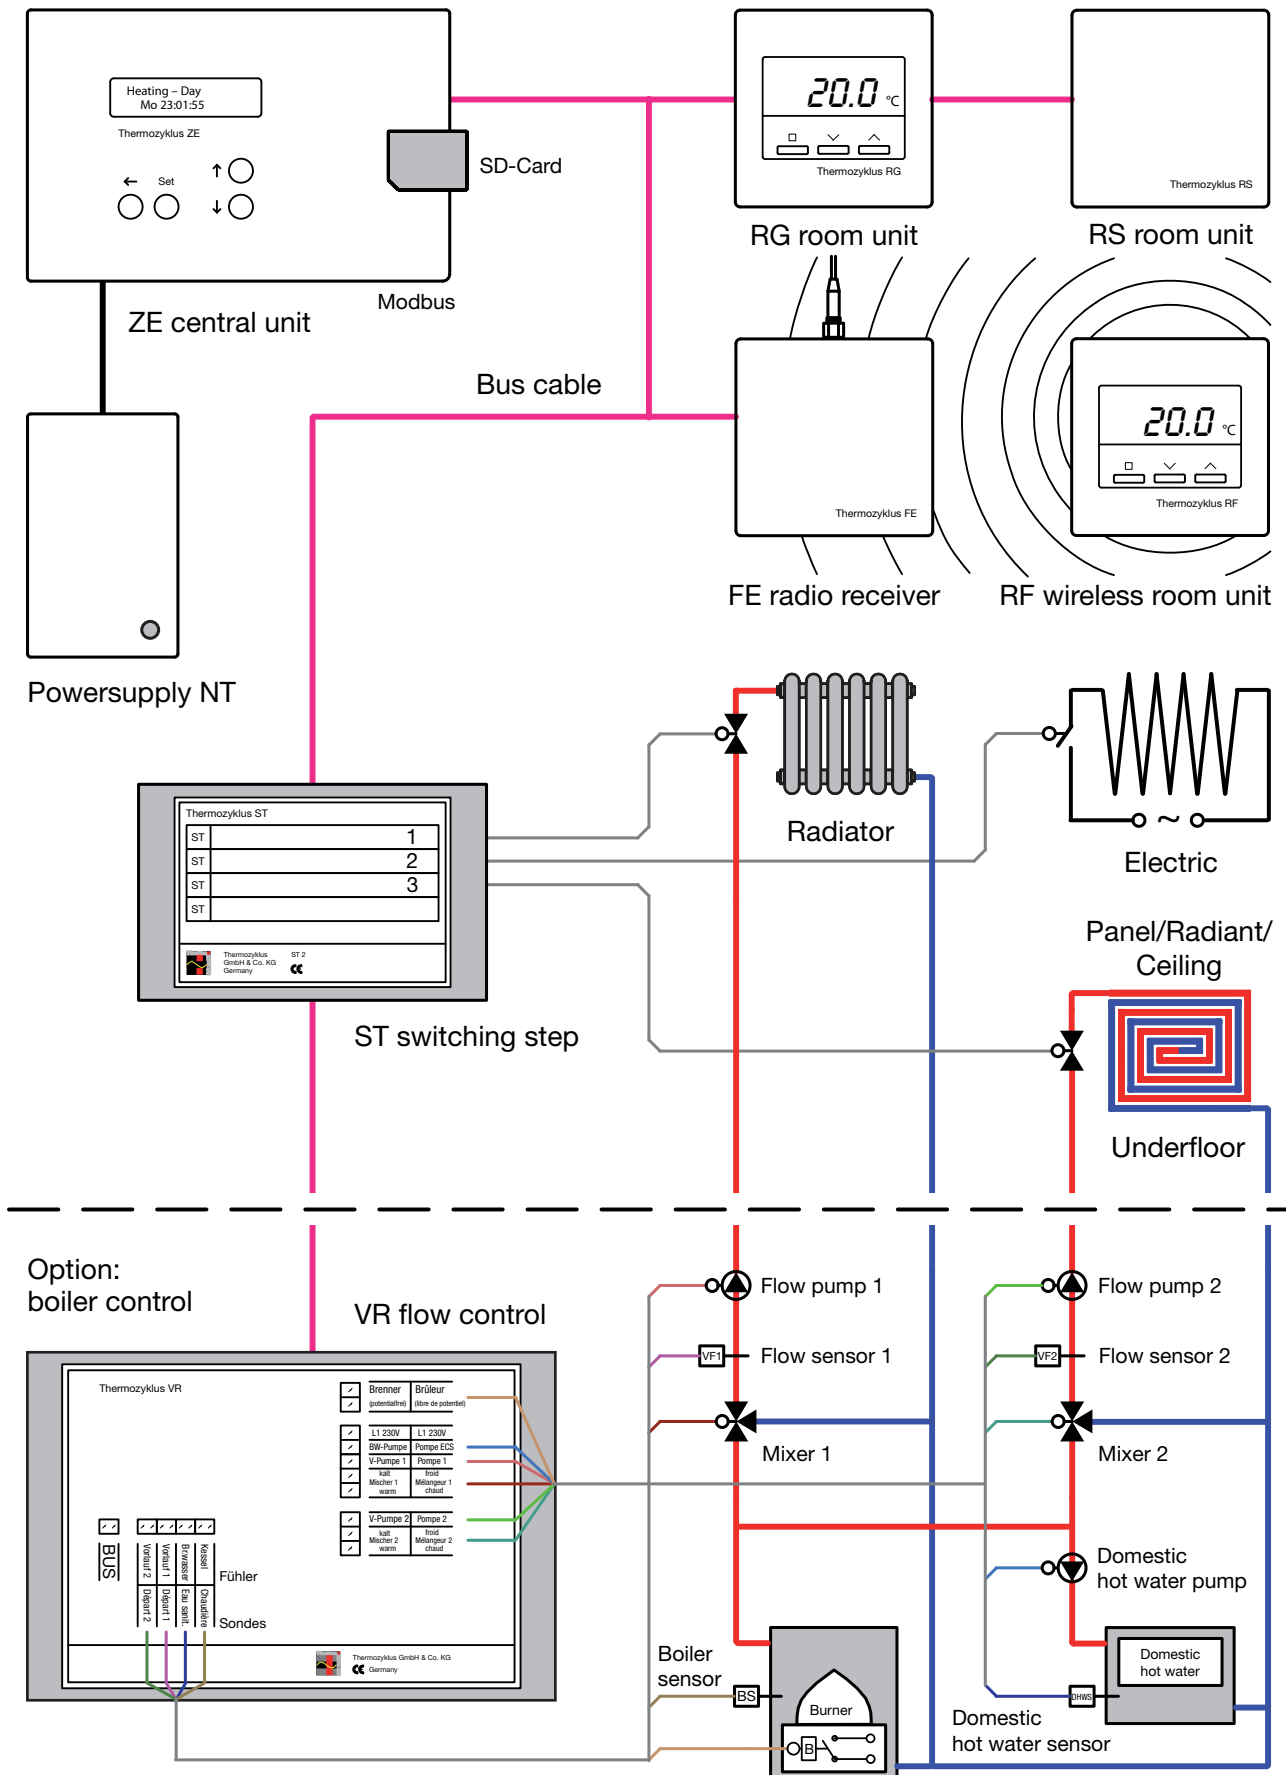

Subject to technical alterations - 02.09